


WATER WELL SAMPLE RESULTS – NITRATES

Port Barrington

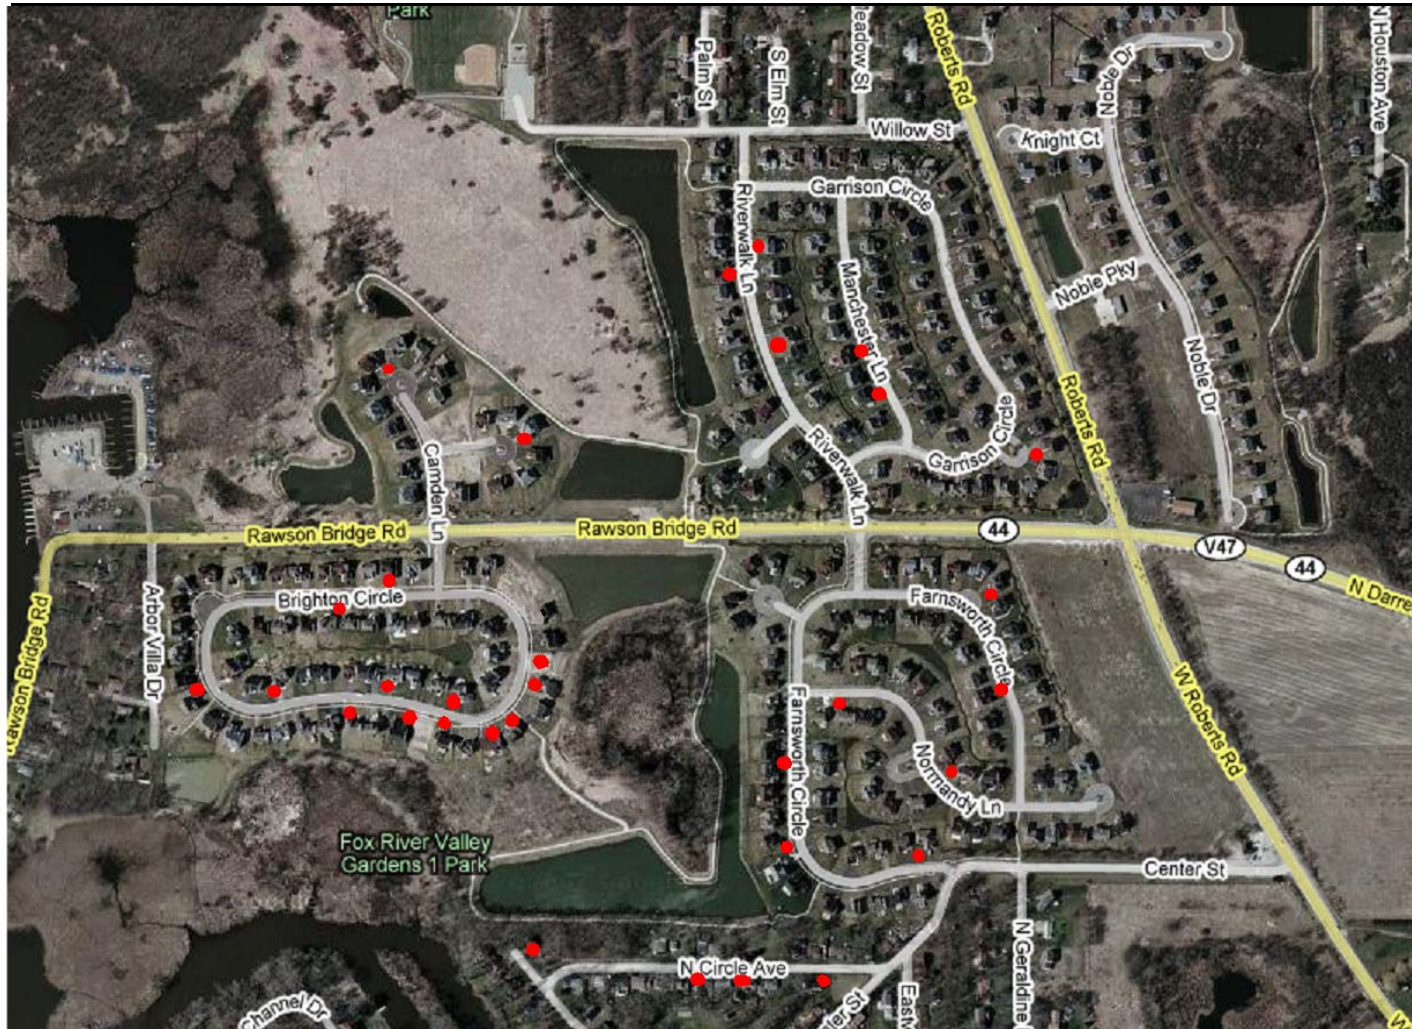

Water well samples collected by McHenry & Lake County Health Dept. Staff

Sample dates:

- Dec. 7, 2007
- Dec. 10, 2007
- Dec. 18, 2007
- Dec. 19, 2007
- Jan. 2, 2008
- Jan. 3, 2008
- Jan. 7, 2008

SAMPLE RESULTS

NITRATES

32 Samples Analyzed -
All samples less than 1 mg/L

Maximum Contamination Level (MCL) Standard as established by the US Environmental Protection Agency (USEPA) less than 10 mg/L

Water Well Sample Locations - ●

Water samples were analyzed by Lake County Health Dept. and McHenry County Dept. of Health.